

#### January 10, 2020

### TO: ALL BIDDERS UNDER RFQ No. 19-3003718, Digital Projector For Police Services Emergency Operations Center

FROM: Department of Purchasing and Contracting, DeKalb County, Georgia

### ADDENDUM NO. 2

Request for Quotes (RFQ) No. 19-3003718, Digital Projector For Police Services Emergency Operations Center is hereby amended as follows:

- 1. The Bid Due Date has been extended until January 15, 2020 at 5:00 P.M. EST.
- 2. We have received questions pertaining to this Request For Quote. The questions and the resulting answers appear below:
  - A. **<u>Question</u>**: What is the ceiling type?

Answer: Unknown

B. **<u>Question</u>**: What is the ceiling height?

Answer: The ceiling height is approximately 15 feet at peak (height to projector is 8ft).

C. <u>Question</u>: What size screens are currently in place? If screens are there; what is the aspect ratio you're needing/wanting?

Answer: One large screen - 63 in (height) x 297 in (width); Aspect Ratio 16 x 9

D. <u>Question</u>: What type of control system are you currently using?

Answer: Crestron Pro 3 Processor

E. **<u>Question</u>**: Do you have the current code that needs to be updated?

Answer: Current code does not need to be updated.

- F. <u>Question</u>: How long are the cable runs from the head-end and/or wall plates feeding the projectors? <u>Answer</u>: Approximately 8 feet
- G. **Question:** What type of projector mounts are you wanting? Motorized or fixed?

Answer: Fixed

H. **Question:** Do you have any pictures of the spaces that you can provide?

Answer: Yes, see attachment hereto.

- 3. It is the responsibility of each bidder to ensure that he/she is aware of all addenda issued under this RFQ. Please sign and return this addendum with your response. You may call Jenifer Chapital, Procurement Technician, 404-371-2569 before the Quotes are due to confirm the number of addenda issued.
- 4. All other conditions remain in full force and effect.

Jenifer Chapital, Procurement Technician

DR/jgc

Attachment: Pictures

#### ACKNOWLEDGEMENT

Date: \_\_\_\_\_

The above Addendum #1 is hereby acknowledged:

(NAME OF BIDDER)

(Signature)

(Title)


## ATTACHMENT

## ADDENDUM NO. 2

# RFQ 19-3003718 – Digital Projectors for DeKalb County Police Services Emergency Operations Center





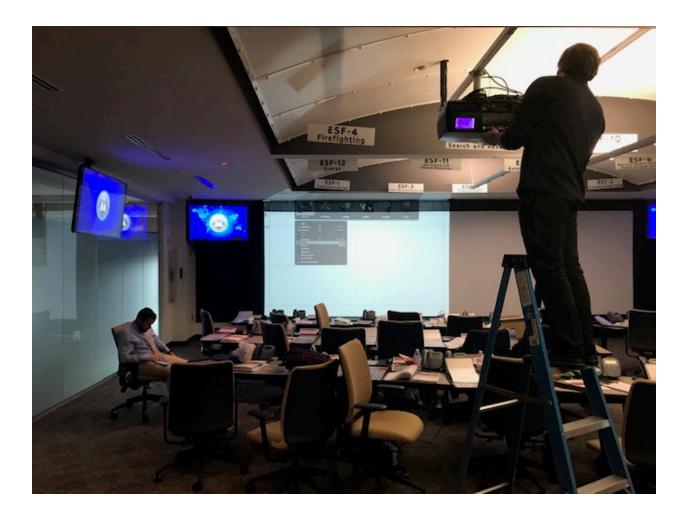











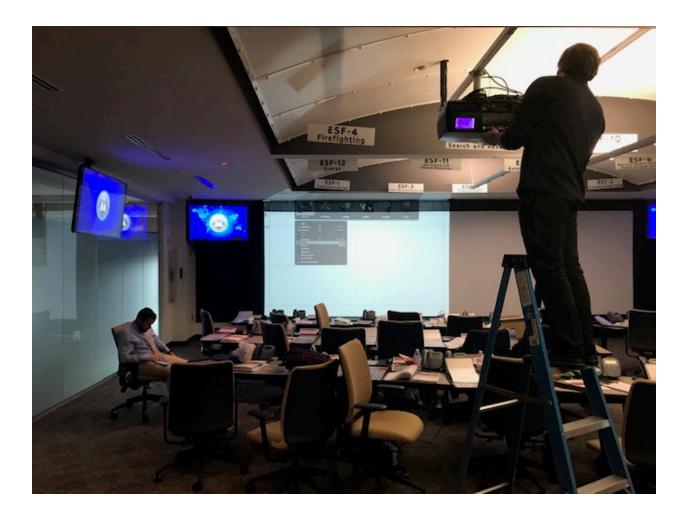



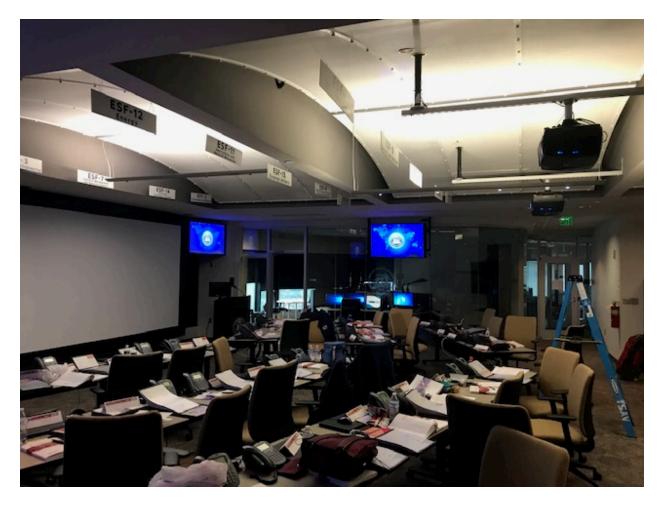

Projector Information X panel Controlled Crestron Pro 3 Processor Mounted Fixed Brackets Height to mounts 116" Distance from screen 286" Aspect Ratio 16 x 9 Picyure size 148" x 77" No on current code